






WHERE TO LOCATE


















Proper extinguisher placement is extremely important. It is natural for a person to use the extinguisher nearest to a fire. Make sure the correct type and size is placed in proximity to a potential hazard. Please review NFPA-10 for recommended types, placement and travel distances, or consult your local **Croker** Representative.

WHERE TO USE

Use your extinguisher only on the types of fires designated by the letter symbols and picture symbols shown below and on the nameplate. The new picture symbols on the right identify the uses. U/L allows blue or black picture symbol background colors, or a combination of the two. The diagonal line indicates non-use classifications.


LETTER SYMBOL	TYPES OF FIRES
A 	ORDINARY COMBUSTIBLES: wood, paper, rubber, fabrics and many plastics.
B 	FLAMMABLE LIQUIDS & GASES: gasoline, oils, paint, lacquer and tar.
C 	FIRES INVOLVING LIVE ELECTRICAL EQUIPMENT
D 	COMBUSTIBLE METALS OR COMBUSTIBLE METAL ALLOYS (No pictures symbol)
K 	FIRES IN COOKING APPLIANCES THAT INVOLVE COMBUSTIBLE COOKING MEDIA vegetable or animal oils and fats

TYPES OF EXTINGUISHERS:

CLASS A	  
CLASS A:B	  
CLASS A:B:C	  
CLASS A:C	  
CLASS B:C	  
CLASS D	
CLASS K	

HOW TO USE

To familiarize users with the proper steps in operating fire extinguishers the **HOW TO USE ILLUSTRATIONS**, as shown below, are depicted on each extinguisher label.

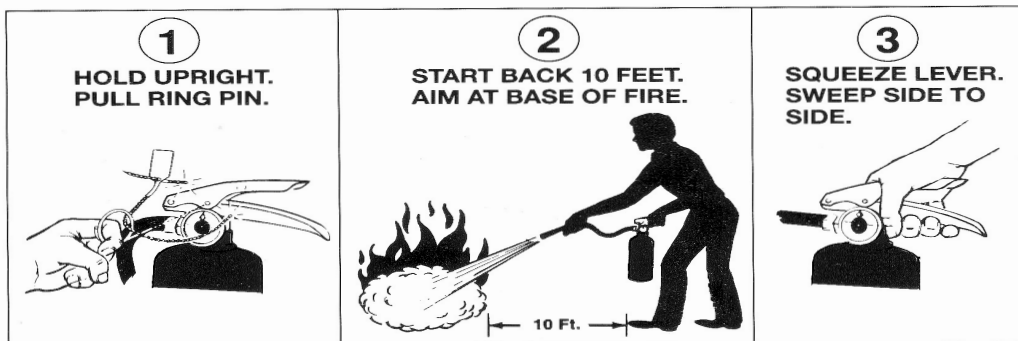

All **Croker** hand portable extinguishers comply with the recommendations of the National Fire Protection Association adopted by Underwriters Laboratories, that all hand portable extinguishers are rated 2A and/or 20B or higher be equipped with discharge hose and horn. In addition all 2A or higher A rated extinguishers have a minimum discharge time of 13 seconds.